


LIGHTING FIXTURE SCHEDULE							
TYPE	DESCRIPTION	MANUFACTURER	CATALOG NUMBER	MOUNTING	LAMPS	VOLTAGE	REMARKS
SA	LED DARK SKY AREA FIXTURE - TYPE IV DIST	LSI INDUSTRIES	SLM-LED-12L-SIL-FT-UNV-DIM-40-PC1208-277-DBZ	POLE - 20'	LED (95W)	208	INTEGRAL PHOTOCCELL
SB	LED DARK SKY AREA FIXTURE - TYPE II DIST	LSI INDUSTRIES	SLM-LED-12L-SIL-2-UNV-DIM-40-PC1208-277-DBZ	POLE - 20'	LED (95W)	208	INTEGRAL PHOTOCCELL
D	LED CANOPY FIXTURE	SEE BUILDING DRAWINGS					


WIRING LEGEND

- 1 2 #8 THHN + 1#10 THHN GND IN 1" SCHEDULE 40 PVC CONDUIT BURIED
30" BELOW GRADE FOR SITE LIGHTING CIRCUIT.

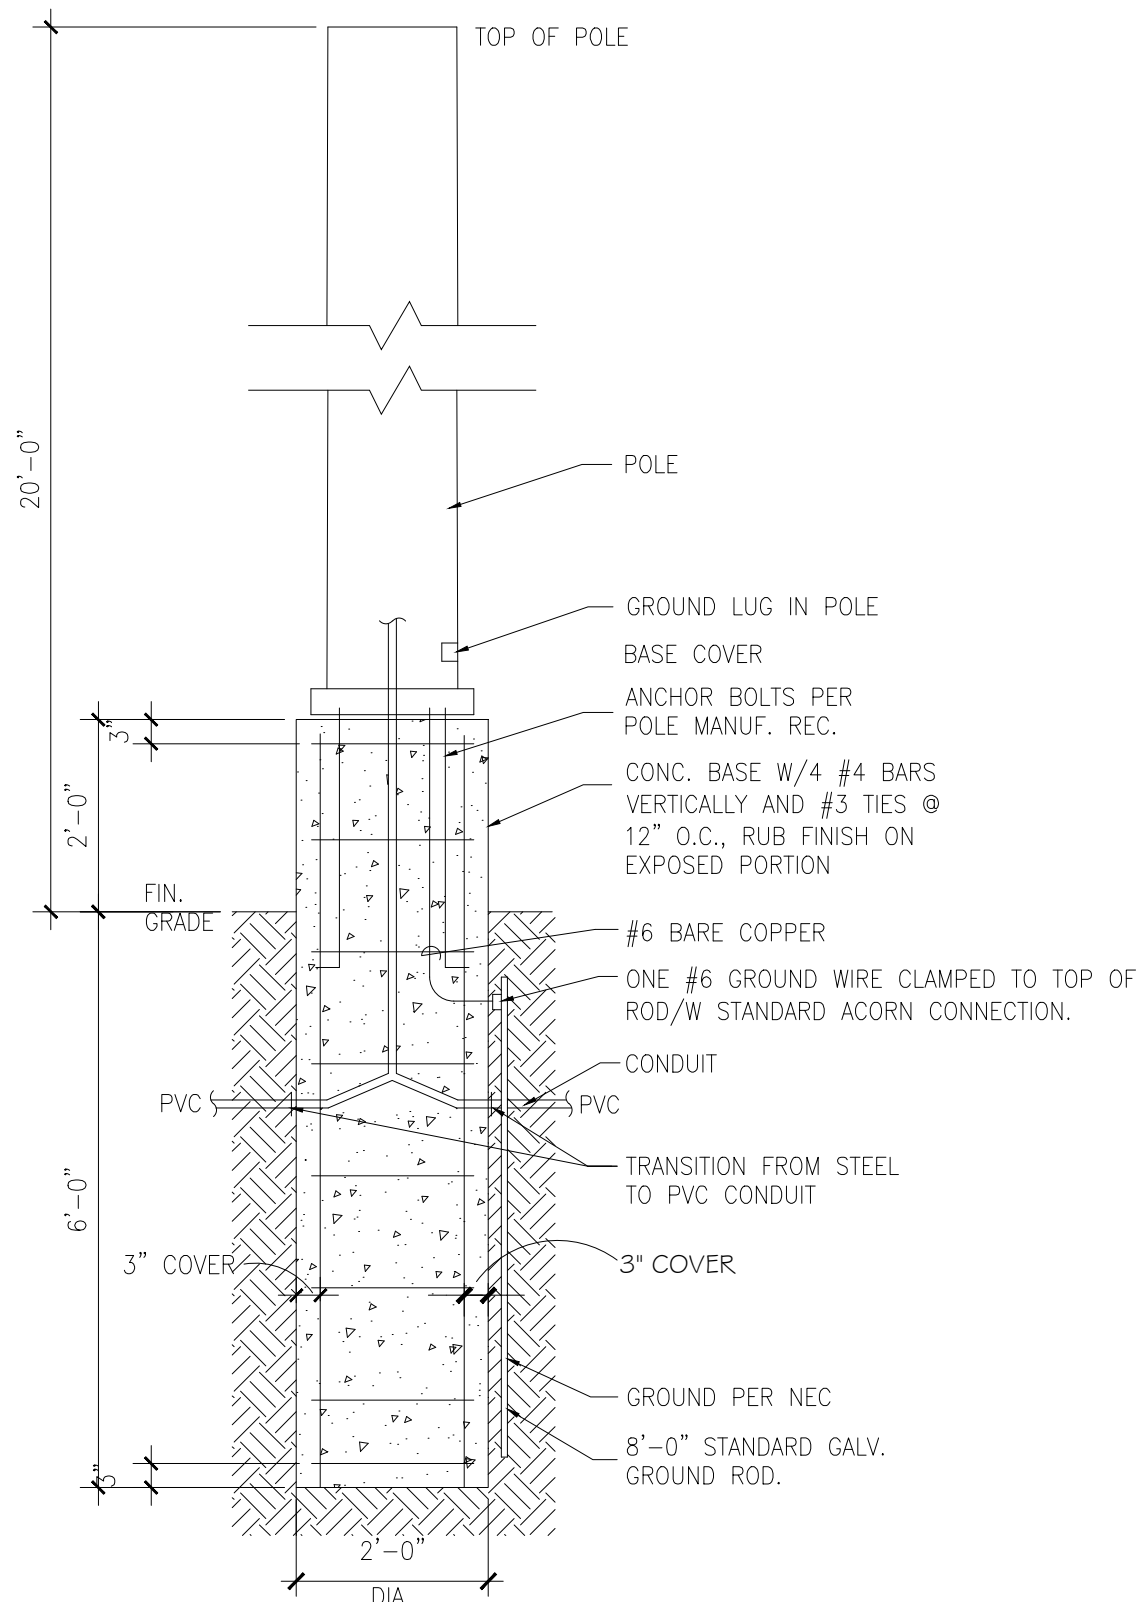

CONFIRM DESIGN OF LOT LIGHT BASE WITH STRUCTURAL ENGINEER AND GEOTECHNICAL ENGINEER, TO INSURE DIAMETER AND DEPTH OF BASE ARE SUITABLE FOR EXISTING SOIL CONDITIONS, WIND LOADS, FROST PROTECTION, ETC.

2 LIGHT STANDARD
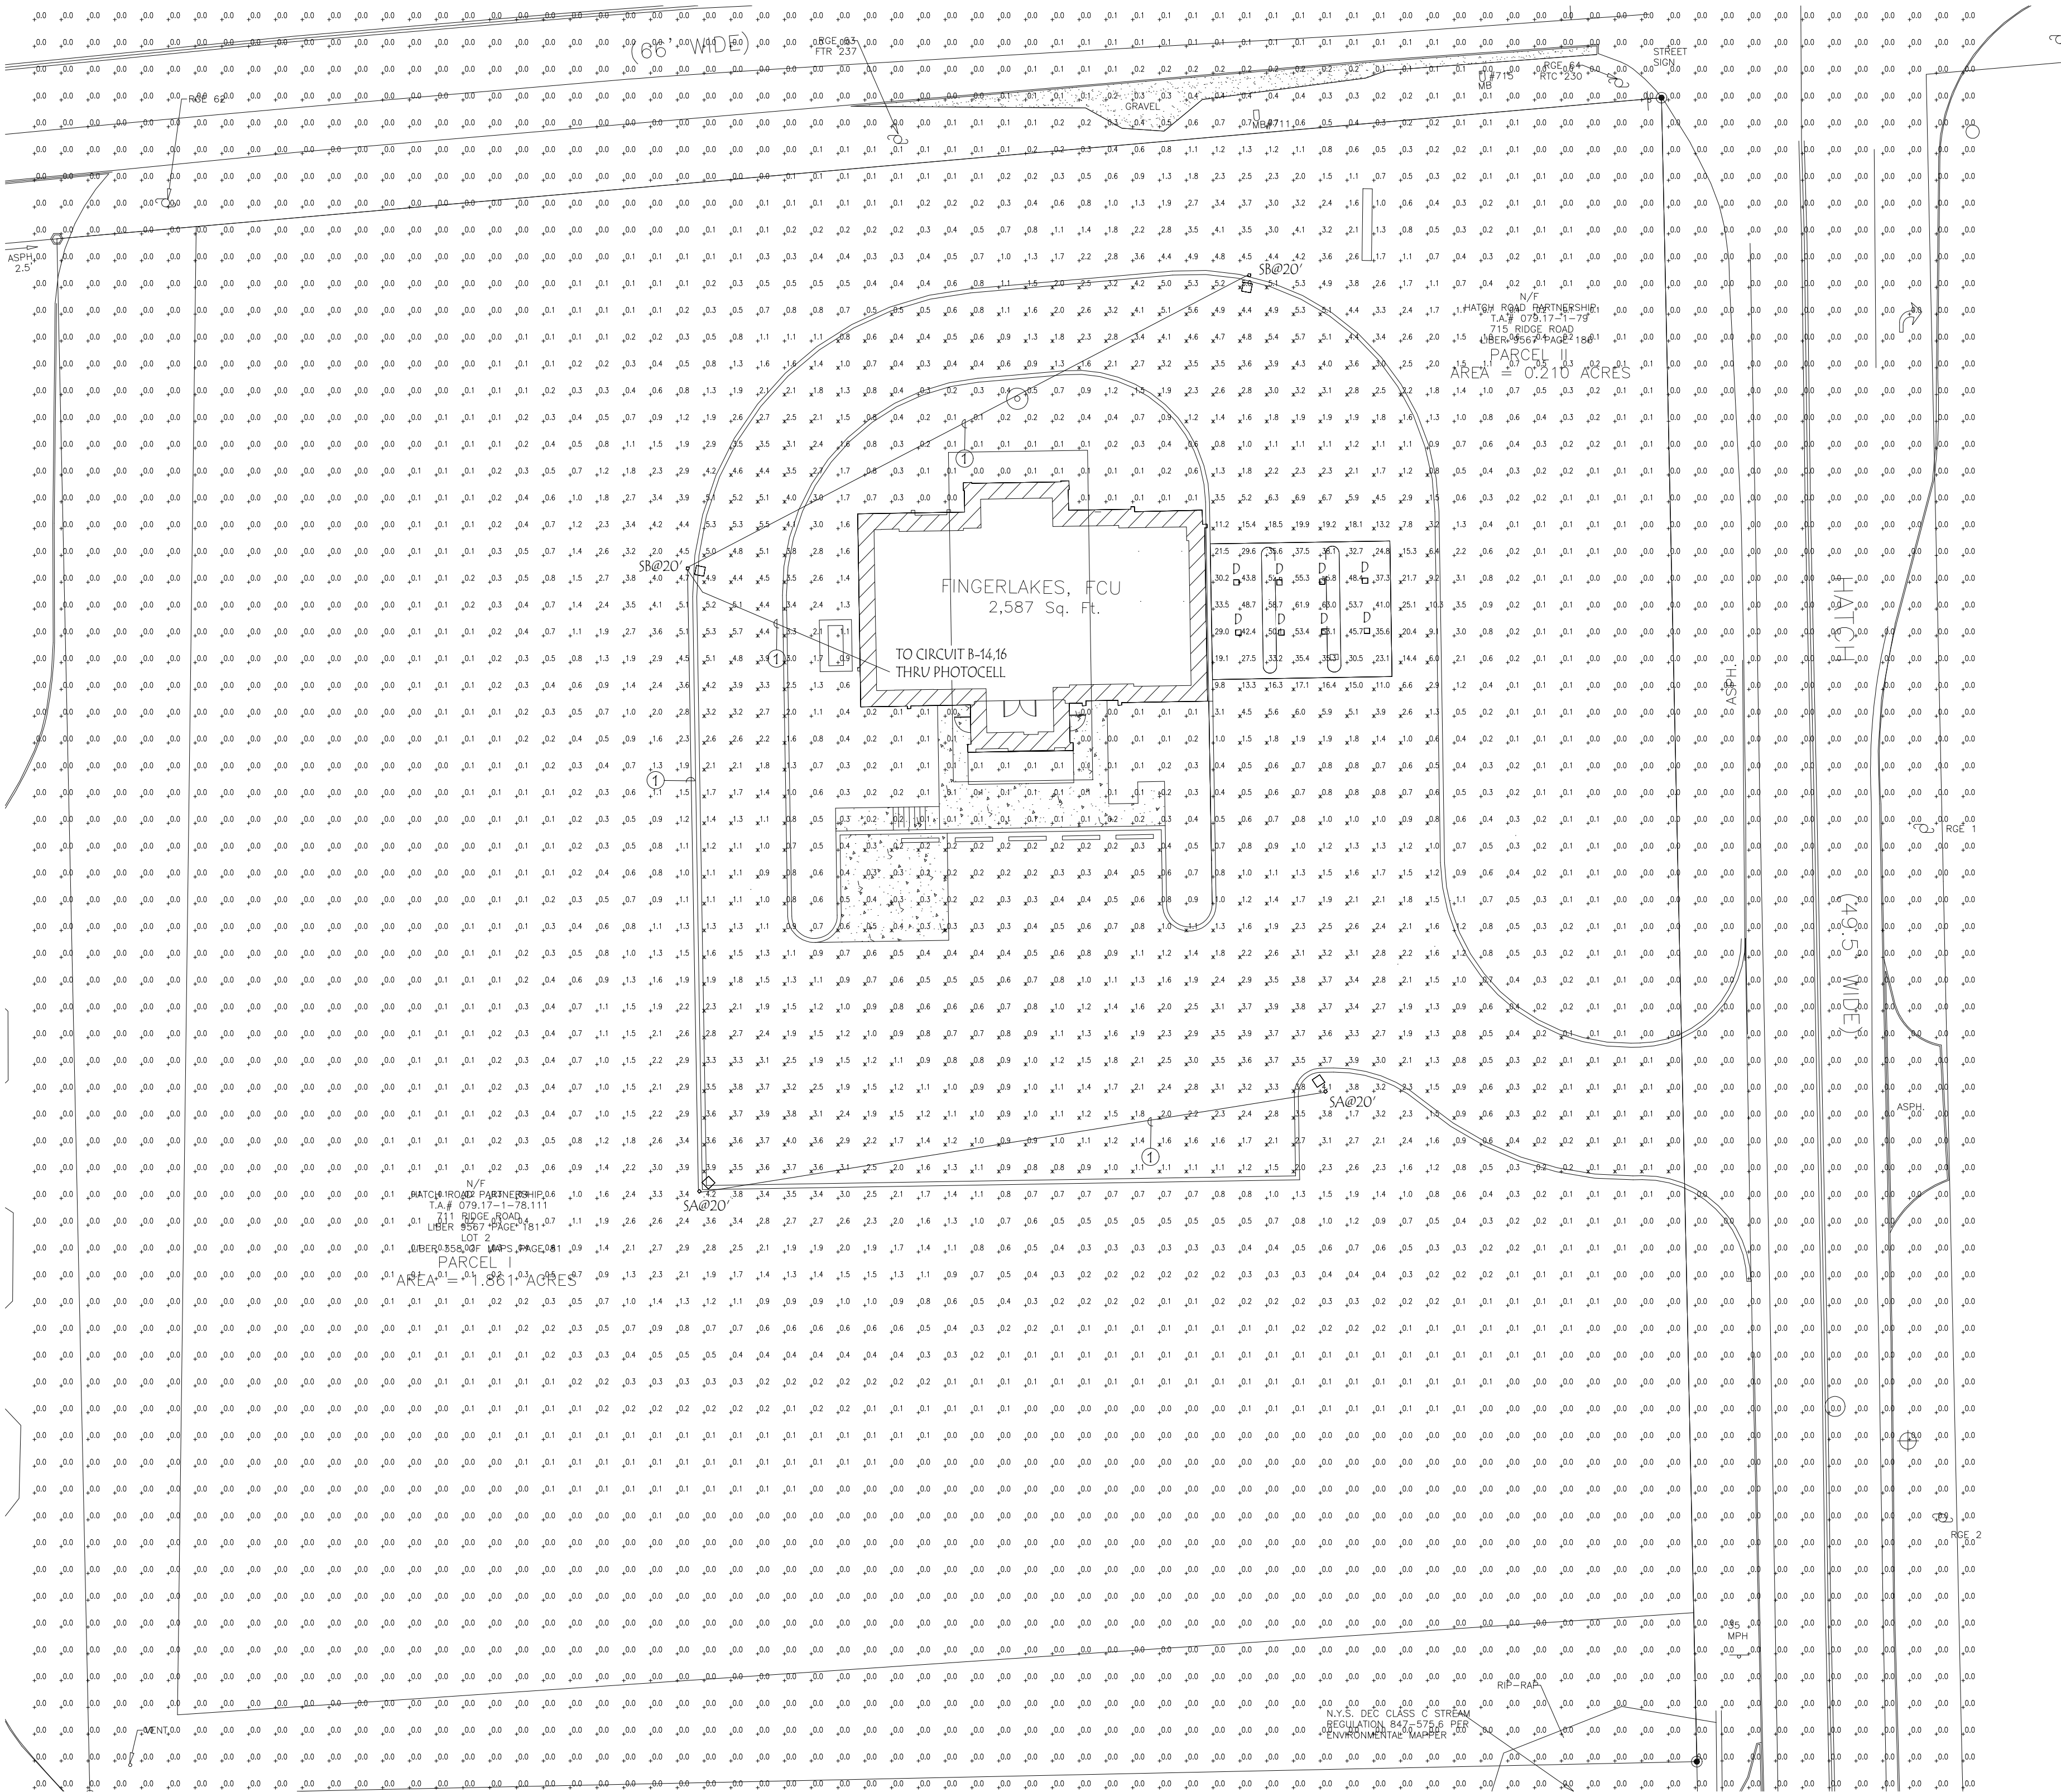
$$1/2'' = 1'-0''$$


SITE PHOTOMETRIC PLAN

$$\sqrt{1^\circ} = 20'$$